


Process controller with PROFIBUS DP and Modbus Master/Slave 1/8 DIN - 48 x 96 mm gammadue® series X5 line

Sophisticated multifunction process controller with high level communications

By its three different kinds of serial communications: PROFIBUS DP Slave Modbus Master • Modbus Slave, the gammadue® X5 line can interface, on different levels, with other devices, by exchanging informations, after processing them by mathematical package. The frequency input, added to the traditional inputs. two retransmission or control analogue outputs and four programs allow you to use it for the most diversified




control strategies.







12







ISO 9001 Certified



Tuning

Two methods of tuning are available:

- one shot initial Fuzzy-Tuning
- self-teaching continuous Adaptive-Tuning


Fuzzy-Tuning

Two methods of initial tuning are available:


- Auto-Tuning "one shot" - Natural frequency "one shot" The Fuzzy-Tuning automatically selects one of the two methods which assure the best result for each condition.

The Auto-Tuning method works best on the step response basis.

When activated, if a deviation exists between the Setpoint and process variable larger than 5% of scale range, the controller modifies the output value. Then, in a short time, it calculates the PID parameters and the new algorithm is operational immediately The main advantages of this method are fast calculation and guick implementation.



The Natural frequency method works best when the process variable is very near to the Setpoint. When activated, it causes a process oscillation around the Setpoint value. The main advantage of this method is a reduced disturbance to the process.



Adaptive-Tuning

It is self-teaching and waits for process change to recalculate the new PID parameters. The new PID calculation does not influence the control output, avoiding any disturbance. The PID optimisation is done only when necessary (e.g. Setpoint changes or process disturbances like load changes). No action by the operator is required.

The operating mode of Adaptive-Tuning is safe and user friendly. It tests the process response after a disturbance, it memorises the intensity and frequency of the reaction, then the Adaptive-Tuning checks the new information with its statistical data base.

The correct PID algorithm is then ready to implement. This tuning is ideal for nonlinear processes where the PID parameters must be adapted to changing conditions.



Up to 4 profiles with 16 segments can be programmed. Number of cycles as well as the max. allowed deviation can be configured. The time base can be selected from seconds, minutes and hours. Run, Hold and Stop functions can be performed by means the front keypad, by external commands or by serial communications.

2

Integrity in data copy

Configuration software


Memory chip

A software tool is available to improve both the configuration and the parameterization. All the data can be stored to file. It is also possible to down-load the linearisation of the "custom" input by using the polynomial's coefficients and to configure the PROFIBUS DP profile file.

The memory chip makes possible a fast and safe transfer of data related to the configuration and all parameters. With a simple operation. the information can be stored and copied to the memory chip. The procedure can be protected by a password.



Setpoint programmer

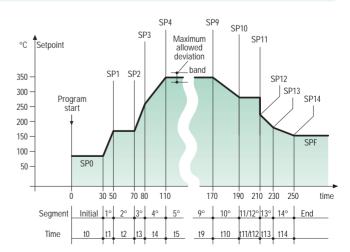

Fast view

The **Fast view** is a password protected review procedure of the 10 most useful parameters. The combination of a luminous and comprehensive display and the ergonomic keypad allows the **immediate access** to the **Fast view**.





PROFIBUS DP Slave

Industrial standard for peripheral devices connection to a machine in a plant.

The protocol installed in this controller, offers the following advantages against the standard normally supplied by other suppliers: • Communications baudrate

- Up to 12 Mb/sec with electric isolation
- The list of data transfer (profile file) is user
 configurable. It can be set by means the gammadue[®] configuration software.



Mathematical package

Modbus Master

Modbus serial

communications allows a controller to exchange informations with other devices, gammadue® series or others with Modbus Slave serial communications (PLC). For instance it is possible to read the acquired value from a gammadue® C1 indicator with alarms and send this value as remote Setpoint to a gammadue® X3 controller; or the gammadue® X5 controller can send the Setpoint profile of the running program to many X1 controllers without Setpoint programmer function. An X5 controller can realize a

simple network for the low level data management. The X5 can also reduce the work of the SCADA and grant the exchange of data in case of its failure.



The mathematical package is

there is in the controller by using a simple set of mathematical operations. For instance it can compare two values by selecting higher or lower, to do the sum or the ratio and so on. **Together with Modbus Master**, it becomes a very powerful



it can, for example, send to different controllers the same Setpoint profile with different values for every controller.

information handler;



AutoLink


Self-configuring supervision software. Major features include monitoring and control of the connected devices, the visualisation by means of instrument faceplates, trend and mimic pages, data archiving as well as report generation. A self-configuring tool automatically polls the connected devices and build up the application software, reducing the start-up costs.

3



gammadue[®] the right solution to your needs

Your needs	Our solutions
High speed data acquisition and signal management	Sampling time: 100ms measure update time: 50 ms
Use of differents actuators	Two analogue outputs, heat/cool (linear, water, oil), valve control output with potentiometer position feedback
Process with time variable characteristic	Two initial and one continuous calculations of the right control parameters
Alarm signalling and diagnostic	Absolute, band and deviation alarm, Latching/Blocking, loop break alarm
Interfacing with other devices	Serial communications at 19200 baud Modbus/Jbus Master and Slave, PROFIBUS DP at 12 Mbaud, two retransmission outputs, Remote Setpoint input, three digital inputs
Temperature profile	4 program with 16 segments, 3 stored Setpoints
Safe and reproducible configuration and parameter settings	Memory chip for data transfer and storing, configuration and parameterisation software
Environmental protection	IP65 front panel protection (indoor, dust and water protection)
Noise immunity	Electromagnetic compatibility
Universal input signals, linear as well as non-linear	Configurable input (TC, RTD, mA, Volt and Δ T, infrared sensor, "custom" linearisation, frequency input up to 20 KHZ)
Reliability and safety	CE compatibility, ASCON is ISO 9001 certified, 3 years warranty
Technical support	Technical application assistance from ASCON sales and after sales service

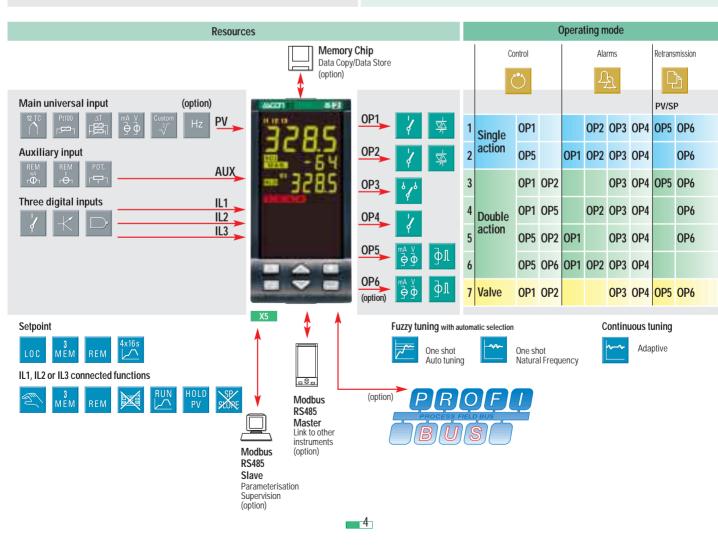

Technical data


Features (at 25°C T. env.amb.)	Description					
Total	From keypad or seri	al communication	the user sel	ects: - the	type of input - the	
configurability	type of Setpoint - th functionality of the a	e type of control a alarms - control pa	lgorithm - th arameter val	e type of o ues - acce	utput - the type and ss levels	
	Common characteristics	A/D converter wi Update measure Sampling time (m 0.110.0 sec. Cor Input filter with e	output adjustable): 60+ 60 digit			
PV input (for signal ranges see table 1)	Accuracy	$0.25\% \pm 1$ digits for $0.1\% \pm 1$ digits (for	e sensors	Between 100 and 240V~error is minimal		
	Resistance thermometer (for Δ T: R1+R2 must be <320 Ω)	Pt100Ω at 0°C 2 or 3 wires (IEC 751) connection °C/°F Burnout (with an selectable selectable combination)		ith any	Max. wire Res.: 20 Ω may (3 wires) Sensitivity: 0.1°C/10°C E. T. <0.1°C/10 Ω Wire Res.	
	Thermocouple	$\begin{array}{llllllllllllllllllllllllllllllllllll$		Line: 150 Ω max		
	DC input (current)	4-20mA, 0-20mA Ri $>$ 30 Ω Burnout. Engineering			Input drift: <0.1% / 20°C Env. Temp. <0.5μV/10Ω Wire Res.	
	DC input (voltage)	0.50 mV, 0-300 mV Rj >10MΩ 1-5, 0-5, 0-10V Rj >10KΩ Rj >10KΩ Rj >10KΩ 1.5 C - 5, 0-10V Rj >10KΩ 1.5 C - 5, 0-10V Rj >10KΩ		on with .9999		
	Frequency (option) 0-2.000 / 0-20.000Hz	Low level ≤2V High level 4-24V Current	(min. range of 100 digit)			
Auxiliary inputs	RemoteSetpoint not isolated accuracy 0.1%	$\begin{array}{l} \text{Bias in engineering units and } \pm \text{ range}\\ \text{R}_{j} = 30\Omega\\ \text{Voltage}\\ 1-5, 0.5, 0-10V\\ \text{R}_{j} = 300 \text{K}\Omega \end{array}$				
	Potentiometer	from 100Ω to $10K\Omega$	alve positi			
Digital inputs 3 logic	The closure of the external contact produces any of the following actions:	Auto/Man mode change, Local/Remote Setpoint mode chan 3 Stored Setpoint activation, keyboard lock, measure hold, slope inhibit and output forcing Program run/hold and selection (if option installed)				
Operating mode and Outputs	1 single or double ad	ction P.I.D. loop or (On/Off with 1	, 2, 3 or 4 al	arms	
	Algorithm	P.I.D. with oversh algorithm, for cor	oot control o htrolling moto	r On/Off wi prised posit	th valve drive ioners	
	Proport. band (P)	0.5999.9%			-	
	Integral time (I) Derivative time (D)	19999 sec 0.1999.9 sec enabled				
				disabled		
	Error dead band	0.110.0 digit				
	Overshoot control Manual reset	0.011.00				
	Cycle time (Time				Single action	
	poportional only) Min./Max	0.2100.0 sec			PID algorithm	
	output limits	0100% separately adjustable				
	Control output	0.01 00.000//				
	rate limit Soft-start	0.0199.99%/sec				
Control mode	rate limit Soft-start output value Output safety	1100% time 19999 sec	; (enabled disabled		
Control mode	rate limit Soft-start output value Output safety value Control output	1100%	; (
Control mode	rate limit Soft-start output value Output safety value Control output forcing value Control output	1100% time 19999 sec -100100%	;	disabled	On/Off algorithm	
Control mode	rate limit Soft-start output value Output safety value Control output forcing value	1100% time 19999 sec -100100% -100100%	;	disabled	On/Off algorithm	
Control mode	rate limit Soft-start output value Output safety value Control output forcing value Control output hysteresis Dead band Cool proportional band (P)	1100% time 19999 sec -100100% -100100% 05% Span in e	;	disabled	On/Off algorithm	
Control mode	rate limit Soft-start output value Output safety value Control output forcing value Control output hysteresis Dead band Cool proportional band (P) Cool integral time (I)	1100% time 19999 sec -100100% -100100% 05% Span in e 0.05.0%	ngineering u	nits	Double action	
Control mode	rate limit Soft-start output value Output safety value Control output forcing value Control output hysteresis Dead band Cool proportional band (P) Cool integral time (I) Cool derivative time (D)	1100% time 19999 sec -100100% -100100% 05% Span in e 0.05.0% 0.5999.9%	ngineering u	nits		
Control mode	rate limit Soft-start output value Output safety value Control output forcing value Control output hysteresis Dead band Cool proportional band (P) Cool integral time (I) Cool derivative time (D) Cool cycle time (Time proportional only)	1100% time 19999 sec -100100% -100100% 05% Span in e 0.05.0% 0.5999.9% 19999 sec	ngineering u	nits	Double action PID algorithm	
Control mode	rate limit Soft-start output value Output safety value Control output forcing value Control output hysteresis Dead band Cool proportional band (P) Cool integral time (I) Cool derivative time (D) Cool cycle time (Time	1100% time 19999 sec -100100% -100100% 05% Span in e 0.05.0% 0.5999.9% 19999 sec 0.19999 sec	ngineering u	nits	Double action PID algorithm	

Input type	Scale range
	-99.9300.0 °C
	-99.9572.0 °F
RTD Pt100 IEC751	-200600 °C
	-3281112 °F
RTD 2xPt100	-50.050.0 °C
IEC751 per ∆T	-58.0122.0 °F
TC L Fe-Const	<u> </u>
DIN43710	321112 °F
TC J Fe-CU45% NI	
IEC584	0111000 0
TC T Cu-CuNi	<u>321112 °F</u> -200400 °C
IEC584	200111100 0
TC K Cromel-Alumel	<u>-328752</u> °F 01200 °C
IEC584	322192 °F
TC S Pt10% Rh Pt	01600 °C
IEC584	322912 °F
TC R Pt13% Rh Pt	<u>322912 F</u>
IEC584	322912 °F
TC B Pt30% Rh Pt 6%	<u></u>
IEC584	323272 °F
TC N Nicrosil-Nisil	
IEC584	322192 °F
TC E Ni10% CR CuNi	<u></u>
IEC584	321112 °F
IL0004	01100 °C
TC NI-NiMo18%	322012 °F
TC D W3%Re 25%Re	02000 °C
IEC584	323632 °F
TC C W5%Re W26%Re	02000 °C
IEC584	323632 °F
0/420 mA	JZJUJZ I
050/300 mV	Configurable
0/15 V	engineering units
010 V	mA, mĬ, V, bar, psi, Rh, ph
Custom scale	On request
Frequency (option)	02KHz or 020KHz


Table 1: PV input

Features (at 25°C T. env.amb.)	Description							
(at 25 G T. env.ani0.)	Motor travel t	ime	1	15600 sec				
Control mode			,	to 0.15.0%		Valve drive PID	algorithm	
Control mode	Feedback po			100Ω10KΩ				
OP1-OP2 outputs	SPST relay N.O., 2A/250V~ for resistive load Triac, 1A/250V~ for resistive load							
OP3 output	SPDT relay N.O., 2A/250V~ for resistive load							
OP4 output				- for resistive lo				
Analogue / digital OP5 and OP6 (option) outputs	Control or PV/SP S retransmission R		Galvanic isolation: 500V~ /1 min Short circuit protected		Analogue: 0/15V, 010V, 500Ω / 20mA max 0/420mA, 750Ω /15V max Digital: 0/24V- ±10% - 30mA max for solid state relay			
	Hysteresis 0.		engineering ur	nits				
		Active				Deviation threshold ±range		
AL1- AL2 - AL3		Active	0	Action type			range	
AL4 alarms		ACTIVE	IUW	5.			lerange	
	Action	Cnoold		Sensor brea	ak, heater	break alarm		
		Specia function		Acknowled	ge (latchii	ng), activation inhib	it (blocking)	
		· anoth		Connected	to Timer o	r program (if option	s installed) (OP3,OP4)	
	Local + 3 stor	ed				s 0.1999.9 digit/		
	Remote only			(OFF=0)		Ũ	-	
	Local and Re			Low limit:				
Setpoint	Local with tri			from low range to high limit				
	Remote with		High limit:		mait to bi	it to high range		
	Programmabl	e If op					ionev input	
Programmable	Installed Remote Setpoint not available with nequency input							
Setpoint								
(optional)	Time values in seconds, minutes and hours Start, stop, hold, etc. activated from the keypad, digital input and serial line							
	Fuzzy-Tuning type. The controller selects automatically Step response							
- ·	the best method according to the process conditions Natural frequency							
Tuning	Adaptive Tune self-learning, not intrusive, analysis of the process response to perturbations and continuous calculation of the PID parameters					esponse to		
Auto/Man	Standard with bumpless function,							
selection	by keypad, di	gital or	serial	communicatio				
Serial comm.s (option)	RS 485 isolated, SLAVE Modbus/Jbus protocol, 1200, 2400, 4800, 9600, 19.200 bit/sec 3 wires RS 485 isolated, MASTER Modbus/Jbus protocol, 1200, 2400, 4800, 9600, 19.200 bit/sec 3 wires							
				ated, PROFIBU nax lenght 100r		otocol, from 9600 VIb/sec.)	bit/sec	
Auxiliary supply	+24– ± 20% 30mA max - for external transmitter supply							
	Measure input	nput automatic a			of out of range, short circuit or sensor break with activation of the safety strategies and alerts on display d forcing value -100%100% separately adjustable			
Operation	Control output	-	100%.	100%		•	J	
alarm safety	Parameters				r and configuration data are stored in a non volatile or an unlimited time			
	Access protection		Password to access the configuration and parameters data Fast view					
	Power suppl (fuse protect	y ed)	24~ (-15 [-15% +	- 25%)	0Hz and	24V- (continuous)	5W max	
Conorol	Safety					1010-1), installatio	n class 2 (2500V)	
General characteristics	Electromagn	etic (on class 2, instr ance to the CE				
	Protection EN60529 (IEC		IP65 front panel					
	Dimensions		/ ₈ DIN	- 48 x 96, depth	ח 110 mm	n, weight 380 gr a	рх.	
						. <u>.</u>		


Electrical wirings



Dimensions



Panel cut-out



Ordering codes

	Line	Basic mo	Accessories			
Model:	X 5	AB	C D	-	E F	G 0
Power supply			İİ		İİ	Ī
Outputs						
Serial/Mathematical package						
Options						
Setpoint programmable						
Instr. handbook						
Colour						

Power suppy A 100-240V- (-15% +10%) 3 24V- (-25% +12%) or 24V- (-15% +25%) 5 OPI-OP2 outputs B Relay-Relay 1 Triac-Triac 5 Serial communications/Mathematical package 0 Mathematical package 0 Not fitted 0 Mathematical package 1 RS 485 Modbus/Jbus SLAVE + Mathematical package 5 SR 485 Modbus/Jbus SLAVE + Mathematical package 6 PROFIBUS DP SLAVE + Mathematical package 7 RS 485 Modbus/Jbus SLAVE + Mothematical package 7 RS 485 Modbus/Jbus SLAVE + Mothematical package 7 RS 485 Modbus/Jbus SLAVE + PROFIBUS DP SLAVE + Mathematical package 7 RS 485 Modbus/Jbus SLAVE + PROFIBUS DP SLAVE + Mathematical package 8 Options D 0 None 0 1 Second analogue/digital output (OP6) 4 Frequency input + second analogue output (OP6) (Remote Setpoint not available) 6 Setpoint programmer E 0 Not fitted 0 0 Four 1'16 segments" programs		•
24V- (-25% +12%) or 24V- (-15% +25%) 5 OP1-OP2 outputs B Relay-Relay 1 Triac-Triac 5 Serial communications/Mathematical package C Not fitted 0 Mathematical package 1 RS 485 Modbus/Jbus SLAVE + Mathematical package 5 RS 485 Modbus/Jbus SLAVE + Mathematical package 6 PROFIBUS DP SLAVE + Mathematical package 7 RS 485 Modbus/Jbus SLAVE+PROFIBUS DP SLAVE + Mathematical package 7 RS 485 Modbus/Jbus SLAVE+PROFIBUS DP SLAVE + Mathematical package 7 RS 485 Modbus/Jbus SLAVE+PROFIBUS DP SLAVE + Mathematical package 8 Options 0 None 0 Frequency input (Remote Setpoint not available) 1 Second analogue output (OP6) 4 Frequency input + second analogue output (OP6) (Remote Setpoint not available) 6 Setpoint programmer E Not fitted 0 Four "16 segments" programs 4 Instruction handbook F Italian-English (std) 0 German-English 2 Spanish-English <td>Power supply</td> <td>A</td>	Power supply	A
OP1-OP2 outputs B Relay-Relay 1 Triac-Triac 5 Serial communications/Mathematical package 0 Not fitted 0 Mathematical package 1 RS 485 Modbus/Jbus SLAVE + Mathematical package 5 RS 485 Modbus/Jbus SLAVE + Mathematical package 6 PROFIBUS DP SLAVE + Mathematical package 7 RS 485 Modbus/Jbus SLAVE+PROFIBUS DP SLAVE + Mathematical package 7 RS 485 Modbus/Jbus SLAVE+PROFIBUS DP SLAVE + Mathematical package 8 Options D None 0 Frequency input (Remote Setpoint not available) 6 Second analogue/digital output (OP6) 4 Frequency input + second analogue output (OP6) (Remote Setpoint not available) 6 Setpoint programmer E Noti fitted 0 Four *16 segments" programs 4 Instruction handbook F Italian-English (std) 1 German-English 2 Spanish-English 3 Front case colour G Dark (std) 0		
Relay-Relay 1 Triac-Triac 5 Serial communications/Mathematical package 0 Not fitted 0 Mathematical package 1 RS 485 Modbus/Jbus SLAVE + Mathematical package 5 RS 485 Modbus/Jbus SLAVE + Mathematical package 6 PROFIBUS DP SLAVE + Mathematical package 7 RS 485 Modbus/Jbus SLAVE+MASTER + Mathematical package 7 RS 485 Modbus/Jbus SLAVE+Mathematical package 8 Options D None 0 Frequency input (Remote Setpoint not available) 1 Second analogue/digital output (OP6) 4 Frequency input + second analogue output (OP6) (Remote Setpoint not available) 6 Setpoint programmer E Not fitted 0 Four "16 segments" programs 4 Instruction handbook F Italian-English (std) 0 French-English 1 German-English 2 Spanish-English 3	24V~ (-25% +12%) or 24V– (-15% +25%)	5
Relay-Relay 1 Triac-Triac 5 Serial communications/Mathematical package 0 Not fitted 0 Mathematical package 1 RS 485 Modbus/Jbus SLAVE + Mathematical package 5 RS 485 Modbus/Jbus SLAVE + Mathematical package 6 PROFIBUS DP SLAVE + Mathematical package 7 RS 485 Modbus/Jbus SLAVE+MASTER + Mathematical package 7 RS 485 Modbus/Jbus SLAVE+Mathematical package 8 Options D None 0 Frequency input (Remote Setpoint not available) 1 Second analogue/digital output (OP6) 4 Frequency input + second analogue output (OP6) (Remote Setpoint not available) 6 Setpoint programmer E Not fitted 0 Four "16 segments" programs 4 Instruction handbook F Italian-English (std) 0 French-English 1 German-English 2 Spanish-English 3		
Triac 5 Serial communications/Mathematical package 0 Not fitted 0 Mathematical package 1 RS 485 Modbus/Jbus SLAVE + Mathematical package 5 RS 485 Modbus/Jbus SLAVE + Mathematical package 6 PROFIBUS DP SLAVE + Mathematical package 7 RS 485 Modbus/Jbus SLAVE+PROFIBUS DP SLAVE + Mathematical package 8 Options D None 0 Frequency input (Remote Setpoint not available) 1 Second analogue/digital output (OP6) 4 Frequency input + second analogue output (OP6) (Remote Setpoint not available) 6 Setpoint programmer E Not fitted 0 Four "16 segments" programs 4 Instruction handbook F Italian-English (std) 0 French-English 1 German-English 3 Front case colour G Dark (std) 0		В
Serial communications/Mathematical package C Not fitted 0 Mathematical package 1 RS 485 Modbus/Jbus SLAVE + Mathematical package 5 RS 485 Modbus/Jbus SLAVE + Mathematical package 6 PROFIBUS DP SLAVE + Mathematical package 7 RS 485 Modbus/Jbus SLAVE + Mathematical package 7 RS 485 Modbus/Jbus SLAVE + Mathematical package 7 RS 485 Modbus/Jbus SLAVE + PROFIBUS DP SLAVE + Mathematical package 8 Options D None 0 Frequency input (Remote Setpoint not available) 1 Second analogue/digital output (OP6) 4 Frequency input + second analogue output (OP6) (Remote Setpoint not available) 6 Setpoint programmer E Not fitted 0 Four "16 segments" programs 4 Instruction handbook F Italian-English (std) 0 French-English 1 German-English 2 Spanish-English 3 Front case colour G Dark (std) 0 <td>Relay-Relay</td> <td>1</td>	Relay-Relay	1
Not fitted0Mathematical package1RS 485 Modbus/Jbus SLAVE + Mathematical package5RS 485 Modbus/Jbus SLAVE + MASTER + Mathematical package6PROFIBUS DP SLAVE + Mathematical package7RS 485 Modbus/Jbus SLAVE+PROFIBUS DP SLAVE + Mathematical package8OptionsDNone0Frequency input (Remote Setpoint not available)1Second analogue/digital output (OP6)4Frequency input + second analogue output (OP6) (Remote Setpoint not available)6Setpoint programmerENot fitted0Four "16 segments" programs4Instruction handbookFItalian-English (std)0French-English2Spanish-English2Spanish-English3Front case colourGDark (std)0	Triac-Triac	5
Not fitted0Mathematical package1RS 485 Modbus/Jbus SLAVE + Mathematical package5RS 485 Modbus/Jbus SLAVE + MASTER + Mathematical package6PROFIBUS DP SLAVE + Mathematical package7RS 485 Modbus/Jbus SLAVE + PROFIBUS DP SLAVE + Mathematical package8OptionsDNone0Frequency input (Remote Setpoint not available)1Second analogue/digital output (OP6)4Frequency input + second analogue output (OP6) (Remote Setpoint not available)6Setpoint programmerENot fitted0Four "16 segments" programs4Instruction handbookFItalian-English (std)0French-English2Spanish-English3Front case colourGDark (std)0Oark (std)0		
Not fitted0Mathematical package1RS 485 Modbus/Jbus SLAVE + Mathematical package5RS 485 Modbus/Jbus SLAVE + MASTER + Mathematical package6PROFIBUS DP SLAVE + Mathematical package7RS 485 Modbus/Jbus SLAVE + PROFIBUS DP SLAVE + Mathematical package8OptionsDNone0Frequency input (Remote Setpoint not available)1Second analogue/digital output (OP6)4Frequency input + second analogue output (OP6) (Remote Setpoint not available)6Setpoint programmerENot fitted0Four "16 segments" programs4Instruction handbookFItalian-English (std)0French-English2Spanish-English3Front case colourGDark (std)0Oark (std)0	Serial communications/Mathematical package	С
Mathematical package1RS 485 Modbus/Jbus SLAVE + Mathematical package5RS 485 Modbus/Jbus SLAVE + Mathematical package6PROFIBUS DP SLAVE + Mathematical package7RS 485 Modbus/Jbus SLAVE + PROFIBUS DP SLAVE + Mathematical package8OptionsDNone0Frequency input (Remote Setpoint not available)1Second analogue/digital output (OP6)4Frequency input + second analogue output (OP6) (Remote Setpoint not available)6Setpoint programmerENot fitted0Four "16 segments" programs4Instruction handbookFItalian-English (std)1German-English2Spanish-English3Front case colourGDark (std)0Four (std)0	1 2	0
RS 485 Modbus/Jbus SLAVE + Mathematical package 5 RS 485 Modbus/Jbus SLAVE + MASTER + Mathematical package 6 PROFIBUS DP SLAVE + Mathematical package 7 RS 485 Modbus/Jbus SLAVE+PROFIBUS DP SLAVE + Mathematical package 8 Options D None 0 Frequency input (Remote Setpoint not available) 1 Second analogue/digital output (OP6) 4 Frequency input + second analogue output (OP6) (Remote Setpoint not available) 6 Setpoint programmer E Not fitted 0 Four "16 segments" programs 4 Instruction handbook F Italian-English (std) 1 German-English 2 Spanish-English 3 Front case colour G Dark (std) 0	Mathematical package	1
RS 485 Modbus/Jbus SLAVE+MASTER + Mathematical package 6 PROFIBUS DP SLAVE + Mathematical package 7 RS 485 Modbus/Jbus SLAVE+PROFIBUS DP SLAVE + Mathematical package 8 Options 0 None 0 Frequency input (Remote Setpoint not available) 1 Second analogue/digital output (OP6) 4 Frequency input + second analogue output (OP6) (Remote Setpoint not available) 6 Setpoint programmer E Not fitted 0 Four "16 segments" programs 4 Instruction handbook F Italian-English (std) 0 French-English 1 German-English 2 Spanish-English 3 Front case colour G Dark (std) 0		5
PROFIBUS DP SLAVE + Mathematical package 7 RS 485 Modbus/Jbus SLAVE + PROFIBUS DP SLAVE + Mathematical package 8 Options 0 None 0 Frequency input (Remote Setpoint not available) 1 Second analogue/digital output (OP6) 4 Frequency input + second analogue output (OP6) (Remote Setpoint not available) 6 Setpoint programmer E Not fitted 0 Four "16 segments" programs 4 Instruction handbook F Italian-English (std) 0 French-English 1 German-English 2 Spanish-English 3 Front case colour G Dark (std) 0		
RS 485 Modbus/Jbus SLAVE + PROFIBUS DP ŠLAVE + Mathematical package 8 Options D None 0 Frequency input (Remote Setpoint not available) 1 Second analogue/digital output (OP6) 4 Frequency input + second analogue output (OP6) (Remote Setpoint not available) 6 Setpoint programmer E Not fitted 0 Four "16 segments" programs 4 Instruction handbook F Italian-English (std) 0 French-English 1 German-English 2 Spanish-English 3 Front case colour G Dark (std) 0		7
OptionsDNone0Frequency input (Remote Setpoint not available)1Second analogue/digital output (OP6)4Frequency input + second analogue output (OP6) (Remote Setpoint not available)6Setpoint programmerENot fitted0Four "16 segments" programs4Instruction handbookFItalian-English (std)0French-English1German-English2Spanish-English3Front case colourGDark (std)0		0
None0Frequency input (Remote Setpoint not available)1Second analogue/digital output (OP6)4Frequency input + second analogue output (OP6) (Remote Setpoint not available)6Setpoint programmerENot fitted0Four "16 segments" programs4Instruction handbookFItalian-English (std)0French-English1German-English2Spanish-English3Front case colourGDark (std)0	NO 400 MICLIDUDUS/JDUS SERVETEROTIDOS DE SERVE E MICLIEITATION package	0
None0Frequency input (Remote Setpoint not available)1Second analogue/digital output (OP6)4Frequency input + second analogue output (OP6) (Remote Setpoint not available)6Setpoint programmerENot fitted0Four "16 segments" programs4Instruction handbookFItalian-English (std)0French-English1German-English2Spanish-English3Front case colourGDark (std)0	Ontions	D
Frequency input (Remote Setpoint not available)1Second analogue/digital output (OP6)4Frequency input + second analogue output (OP6) (Remote Setpoint not available)6Setpoint programmerENot fitted0Four "16 segments" programs4Instruction handbookFItalian-English (std)0French-English1German-English2Spanish-English3Front case colourGDark (std)0O0		
Second analogue/digital output (OP6) 4 Frequency input + second analogue output (OP6) (Remote Setpoint not available) 6 Setpoint programmer E Not fitted 0 Four "16 segments" programs 4 Instruction handbook F Italian-English (std) 0 French-English 1 German-English 2 Spanish-English 3 Front case colour G Dark (std) 0		0
Frequency input + second analogue output (OP6) (Remote Setpoint not available) 6 Setpoint programmer E Not fitted 0 Four "16 segments" programs 4 Instruction handbook F Italian-English (std) 0 French-English 1 German-English 2 Spanish-English 3 Front case colour G Dark (std) 0		1
Setpoint programmerENot fitted0Four "16 segments" programs4Instruction handbookFItalian-English (std)0French-English1German-English2Spanish-English3Front case colourGDark (std)0		
Soport programmer D Not fitted 0 Four "16 segments" programs 4 Instruction handbook F Italian-English (std) 0 French-English 1 German-English 2 Spanish-English 3 Front case colour G Dark (std) 0	Frequency input + second analogue output (OP6) (Remote Setpoint not available)	6
Soport programmer D Not fitted 0 Four "16 segments" programs 4 Instruction handbook F Italian-English (std) 0 French-English 1 German-English 2 Spanish-English 3 Front case colour G Dark (std) 0		
Four *16 segments" programs 4 Instruction handbook F Italian-English (std) 0 French-English 1 German-English 2 Spanish-English 3 Front case colour G Dark (std) 0		E
Instruction handbookFItalian-English (std)0French-English1German-English2Spanish-English3Front case colourGDark (std)0		0
Italian-English (std)0French-English1German-English2Spanish-English3Front case colourGODark (std)0	Four "16 segments" programs	4
Italian-English (std)0French-English1German-English2Spanish-English3Front case colourGODark (std)0		
French-English 1 German-English 2 Spanish-English 3 Front case colour G Dark (std) 0	Instruction handbook	F
French-English 1 German-English 2 Spanish-English 3 Front case colour G Dark (std) 0	Italian-English (std)	0
German-English 2 Spanish-English 3 Front case colour G Dark (std) 0		1
Spanish-English 3 Front case colour G Dark (std) 0		2
Front case colour G Dark (std) 0		
Dark (std) 0		
Dark (std) 0	Front case colour	G
Deige		1
	Doigo	

If not differently specified the controller will be supplied with standard version Model: X5 3100-0000

7



ASCON spa

20021 Bollate (Milano) Italy Via Falzarego, 9/11 Tel. +39 02 333 371 Fax +39 02 350 4243 http://www.ascon.it e-mail info@ascon.it

ASCON FRANCE

2 bis, Rue Paul Henri Spaak ST. THIBAULT DES VIGNES F-77462 LAGNY SUR MARNE - Cedex Tél. +33 (0) 1 64 30 62 62 Fax +33 (0) 1 64 30 84 98 e-mail ascon.france@wanadoo.fr

AGENCE SUD-EST Tél. +33 (0) 4 78 90 92 28 Fax +33 (0) 4 78 90 92 17

WORLDWIDE NETWORK OF DIRECT SALES CENTRES, DISTRIBUTORS AND VARS

Europe

Belgium, Cyprus, Croatia, Czech Rep, Finland, France, Germany, Great Britain, Greece, Holland, Ireland, Norway, Portugal, Romania, Russia, Slovenia, Spain, Sweden, Switzerland, Turkey, Ukrain

Americas

Argentina, Brazil, Chile, Colombia, Ecuador, Peru, United States

Over the world

Australia, China, Hong Kong, India, Israel, Malaysia, New Zealand, Singapore, Taiwan, Thailand, South Africa & South East Africa

